



INSTITUT IGH, d.d.  
Laboratorij za građevinsku fiziku  
Building Physics Laboratory  
Janka Rakuše 1, 10000 ZAGREB, CROATIA  
Tel: +385 1/6125 111, Fax: +385 1/6125 100  
www.igh.hr



RN 62570888

Zagreb, 2021-10-11

## TEST REPORT AND ASSESSMENT OF PERFORMANCE BASED ON TESTING No. EN-72570/100/21-210/21

**(based on sampling carried out by the manufacturer)**

Client: SONITUS d.o.o., Tina Ujevića 26, HR-48000 Koprivnica  
Offer: Offer No. 72570-0-0398/19 dated on 2019-05-28  
Building product: absorber Sonitus Acoustics Decosorber Natur Maze  
Manufacturer: SONITUS d.o.o., Tina Ujevića 26, HR-48000 Koprivnica  
Date of receipt of the sample: 2021-09-08  
Laboratory sample No.: LGF 229/21  
Place of testing: INSTITUT IGH, d.d., Materials and Structures Department, IGH Laboratory, Building Physics Laboratory, Janka Rakuše 1, HR-10000 Zagreb, Croatia  
Tested property: Sound absorption  
Decision No.: KLASA: UP/I-360-01/20-08/37, URBROJ: 531-04-2-1-2-21-10 dated on 2021-04-15

Responsible person:   
Tomislav Vučić, univ. spec. aedif.

Head of the Building Physics Laboratory  
  
dr. sc. Mladen Bezjak, dipl. ing. stroj.



Institut IGH d.d. is a notified body of the European Commission for the testing noise absorption of products used in civil engineering with the number: NB 2477 in the NANDO database.

Test results refer only to the tested specimens. Partial copying of this report is not permitted without a written authorization of the Head of the Laboratory. No. of text pages: 7, included annexes: 0.

**Test report No: EN-72570/100/21-210/21**

- Task:** Sound absorption testing of samples delivered by the manufacturer.
- Testing standard:** HRN EN ISO 354:2004 – Acoustics -- Measurement of sound absorption in a reverberation room (ISO 354:2003; EN ISO 354:2003)
- Evaluating standard:** HRN EN ISO 11654:1998 – Acoustics -- Sound absorbers for use in buildings – Rating of sound absorption (ISO 11654:1997; EN ISO 11654:1997)

**Description of tests samples** (information provided by the client):

**PRODUCT NAME :** SONITUS ACOUSTICS DECOSORBER NATUR MAZE

**DESCRIPTION :** mid frequency absorber

**MATERIAL :**

>Polyester foam 25kg / +2kg m<sup>3</sup>, 4 kPa +- 0,6 kPa, fire retardant according to FMVSS302 <100mm/min  
fire retardant according to FMVSS302 <100mm/min


>4mm PLYWOOD

>BLACK FLOCK COATING 1mm

**COLOR :** ANTHRACITE FOAM WITH DIFFERENT FRONT PLATE FINISH

**DIMENSIONS :** 600x600x80mm

**OPEN AREA :** 7,65 %

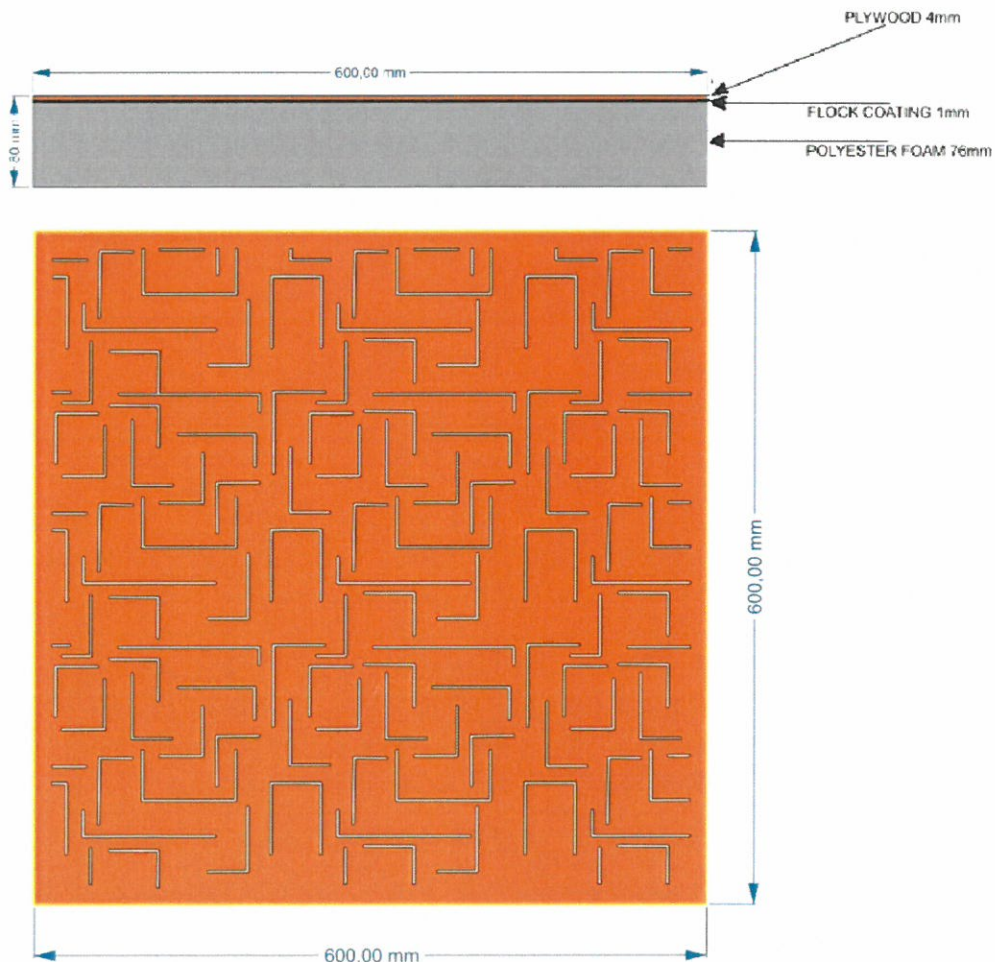

**Test report No: EN-72570/100/21-210/21**

Test sample Absorber Sonitus Acoustics Decosorber Natur Maze have nominal dimensions: 600 mm x 600 mm, thickness: 80 mm, (photo 1 and 2).

Measured mass of the Sonitus Acoustics Decosorber Natur Maze absorber per piece: 1,33 kg.

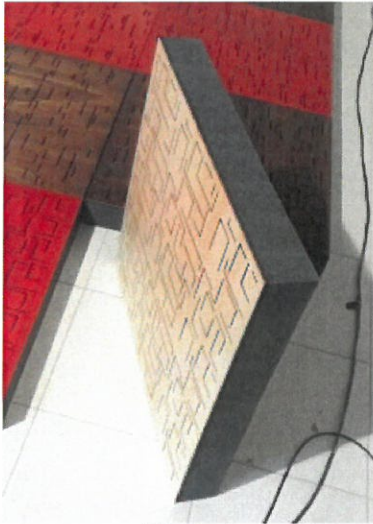


Photo 1

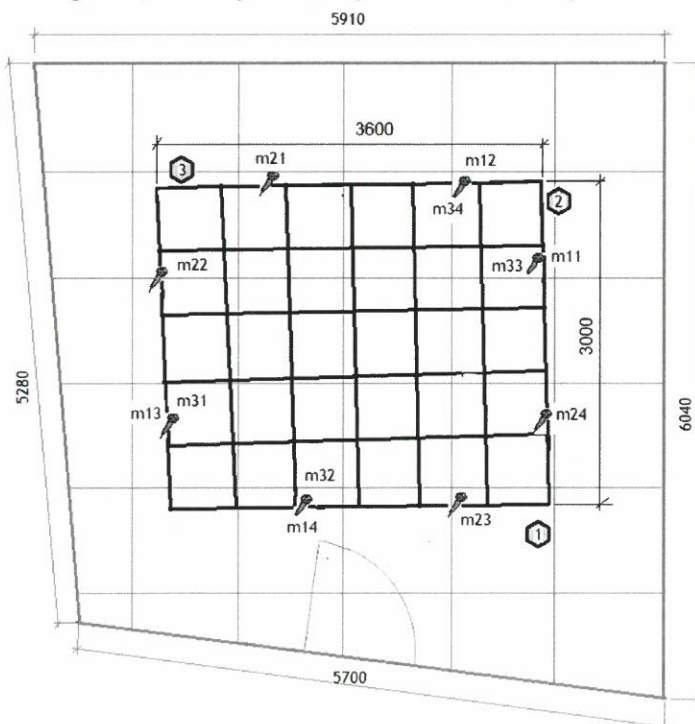


Photo 2

**Installation method of test samples:**

For measuring sound absorption of Sonitus Acoustics Decosorber Natur Maze, 30 pieces of absorber, dimensions: 600 mm x 600 mm, were placed on the floor of the reverberation room and formed a surface of 10,80 m<sup>2</sup> (Sketch 1).

Lateral surfaces of the Sonitus Acoustics Decosorber Natur Maze absorbers hadn't been protected while performing test, so they were a part of the absorption surface (photo 3 and 4), additional 1,02 m<sup>2</sup>.



Sketch 1

**Test report No: EN-72570/100/21-210/21**

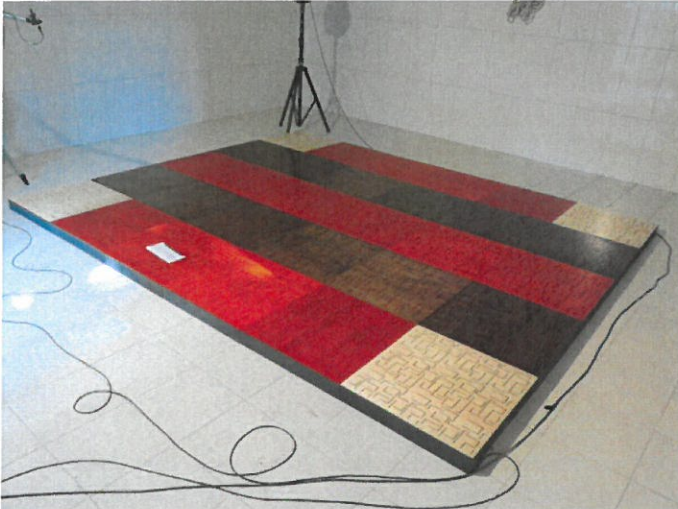


Photo 3

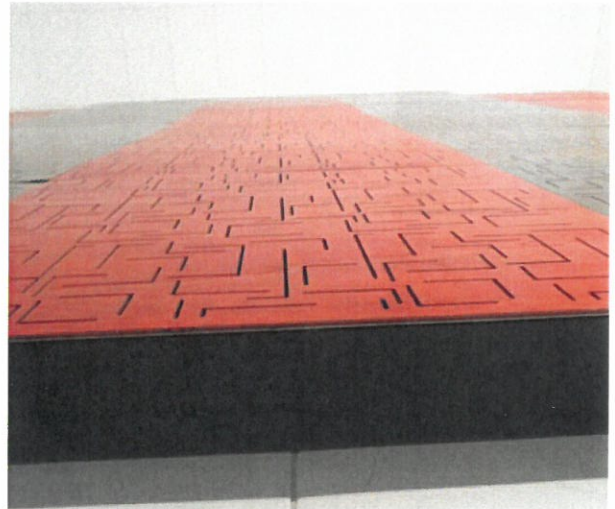


Photo 4

**Description of a reverberation room:**

- volume: 194,8 m<sup>3</sup>,
- area: floor 32,65 m<sup>2</sup>, ceiling: 32,65 m<sup>2</sup>, walls: 136,77 m<sup>2</sup>,
- diffusers: pieces 8, total area: 30,17 m<sup>2</sup>.

**Test conditions:**

- number of microphone positions: 12 (m11... m34),
- number of loudspeaker positions: 3,
- number of averaging on individual position microphone/ loudspeaker: 3.

**Measuring and testing equipment:**

- hand-held analyzer, type 2270 (Dual Channel), Bruel & Kjaer, serial number: 2679276,
- sound pressure calibrator, type 4231, Bruel & Kjaer, serial number: 3023871,
- thermohygrometer, ROTRONIC, type Hygroclip S, laboratory mark 1680, serial number: 23535 011,
- condenser microphone, type 4189, Bruel & Kjaer, serial number: 2670475,
- preamplifier, type ZC 0026, Bruel & Kjaer, serial number: 2877,
- power amplifier, type 2716, Bruel & Kjaer, serial number: 2486522,
- sound source, type 4296, Bruel & Kjaer, serial number: 2485310,
- barometer, serial number: 225558, laboratory mark 1135.

**Test results:**

The sound absorption coefficient ( $\alpha_s$ ) and partical sound absorption coefficient ( $\alpha_p$ ) of tested samples as a function of frequency is shown in table and diagram. In presenting the results, the following symbols are used:

- $f$  – centre frequency of the one-third-octave band (Hz),
- $\alpha_s$  – sound absorption coefficient,
- $\alpha_p$  – partical sound absorption coefficient (for each octave band),
- $T_1$  – reverberation time of the empty reverberation room (s),
- $T_2$  – reverberation time of the reverberation room with test samples (s),
- $\alpha_w$  – weighted sound absorption coefficient.



INSTITUT IGH, d.d.  
Laboratorij za građevinsku fiziku  
Building Physics Laboratory  
Janka Rakuše 1, 10000 ZAGREB, CROATIA  
Tel: +385 1/6125 111, Fax: +385 1/6125 100  
www.igh.hr



Test report No: EN-72570/100/21-210/21

---

## Results of sound absorption measurements of absorber Sonitus Acoustics Decosorber Natur Maze

Client: SONITUS d.o.o., Tina Ujevića 26, HR-48000 Koprivnica  
Manufacturer: SONITUS d.o.o., Tina Ujevića 26, HR-48000 Koprivnica  
Building product: absorber Sonitus Acoustics Decosorber Natur Maze  
Laboratory sample No.: LGF 229/21  
Measuring assembly made by: laboratory staff  
Date of test: 2021-09-30  
Area of test samples:  $S = 11,82 \text{ m}^2$   
Volume of the reverberation room:  $V = 194,8 \text{ m}^3$

Climatic conditions in the empty reverberation room (2021-09-30):

- temperature 21,8 °C,
- relative air humidity 56,5 %,
- air pressure: 100,3 kPa,


Climatic conditions in the reverberation room with test samples (2021-09-30):

- temperature 21,7 °C
- relative air humidity 47,9 %
- air pressure: 100,4 kPa

Test report No: EN-72570/100/21-210/21

Frequency $f$ (Hz)	Reverberation time of empty reverberation room $T_1$ (s)	Reverberation time of reverberation room with test samples $T_2$ (s)	Sound absorption coefficient $\alpha_s$
100	17.42	7.94	0.18
125	12.98	4.19	0.43
160	12.27	3.52	0.54
200	10.90	2.66	0.75
250	9.58	2.06	1.01
315	9.44	2.13	0.96
400	8.88	2.06	0.99
500	9.32	2.15	0.95
630	8.96	2.19	0.92
800	8.09	2.25	0.85
1000	7.75	2.29	0.82
1250	7.16	2.28	0.79
1600	6.49	2.33	0.73
2000	5.84	2.40	0.65
2500	5.24	2.36	0.60
3150	4.42	2.29	0.53
4000	3.62	2.12	0.47
5000	2.88	1.89	0.41


Sound absorption coefficient:

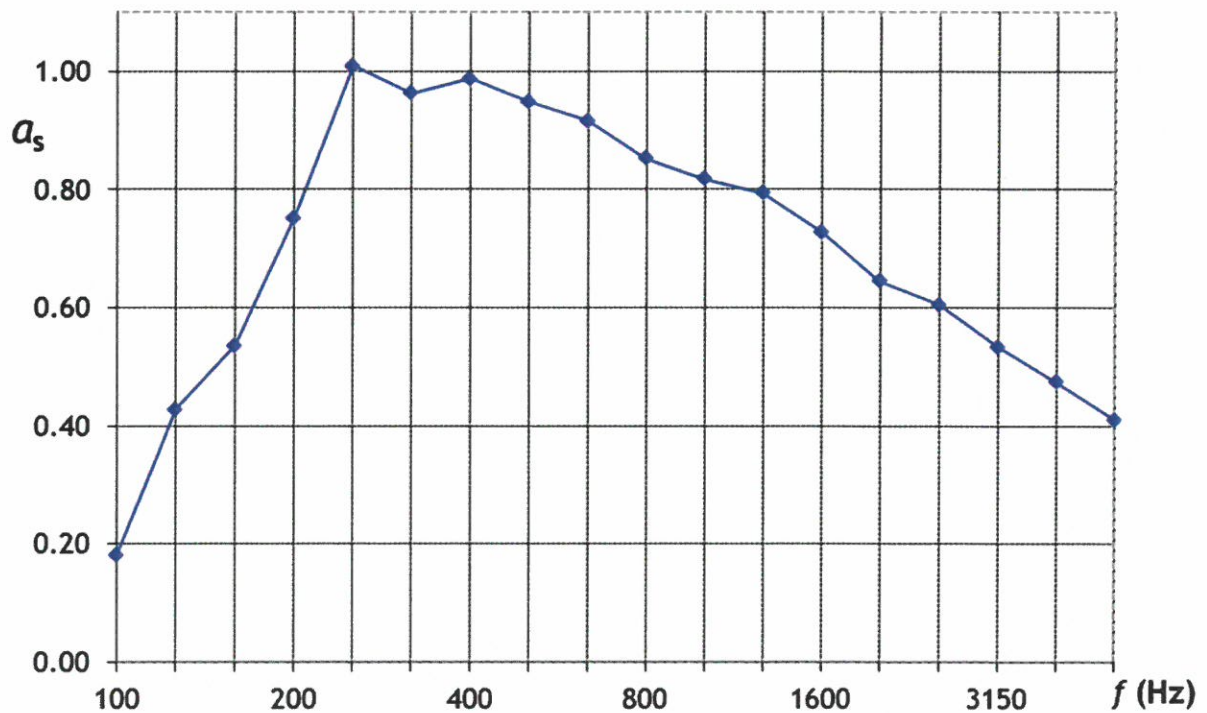

Test report No: EN-72570/100/21-210/21

**Classification of the sound absorption measurement results of  
 absorber Sonitus Acoustics Decosorber Natur Maze, according to HRN EN ISO 11654:  
 1998**

Frequency	Curve of shifted reference values	Practical sound absorption coefficient
$f$ (Hz)		$\alpha_p$
125		0.40
250	0.45	0.90
500	0.65	0.95
1000	0.65	0.80
2000	0.65	0.65
4000	0.55	0.45

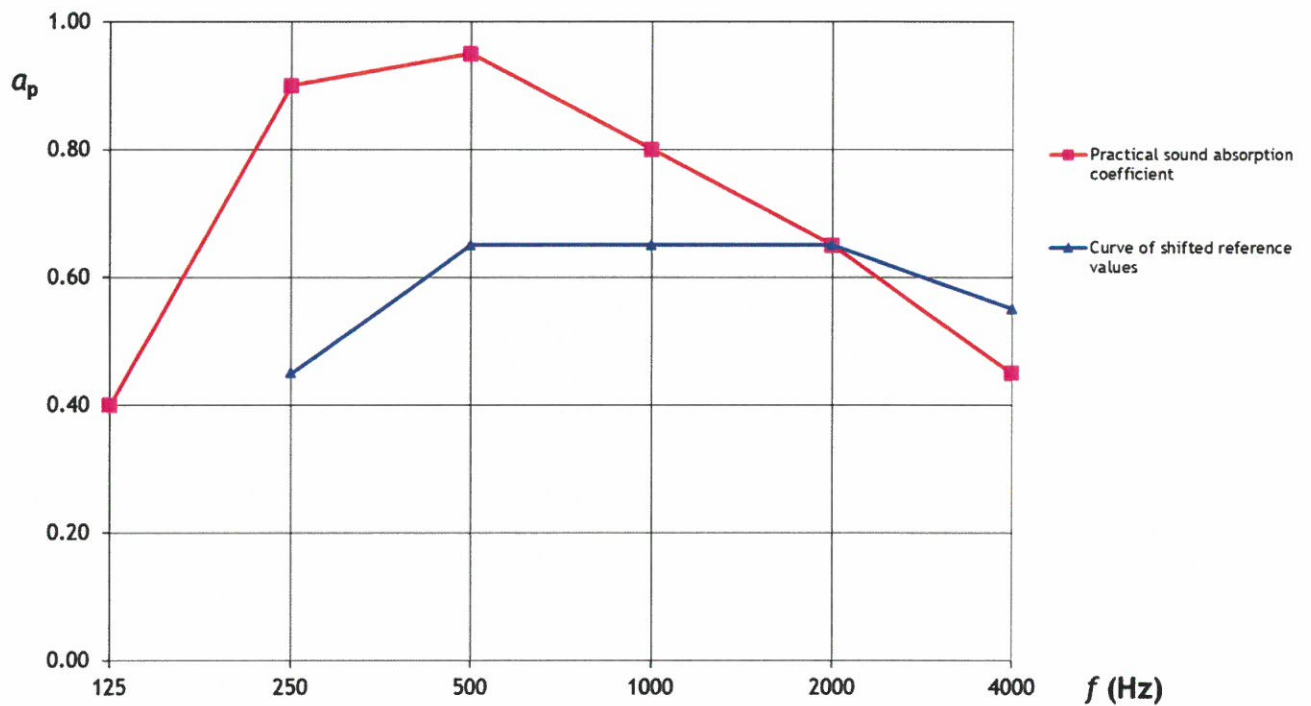

Absorber Sonitus Acoustics Decosorber Natur Maze manufactured by SONITUS d.o.o., Tina Ujevića 26, HR-48000 Koprivnica	
Weighted sound absorption coefficient	Sound absorption class according to HRN EN ISO 11654:1998
$\alpha_w = 0,65(LM)$	<b>C</b>